


NOTE:

1. CONDUIT SHALL BE 2 1/2" RIGID METAL.
2. MINIMUM HEIGHTS FOR SERVICE CONDUCTORS TO BE  
18 FT. ABOVE ROADWAYS.  
12 FT. ABOVE RESIDENTIAL PROPERTY OR DRIVEWAY.  
10 FT. ABOVE ANY PLATFORM, DECK PORCH PATIO OR BALCONY.

WEATHER HEAD WITH ENOUGH WIRE HANGING OUT  
TO MAKE CONNECTION W/ 18" DRIP LOOP

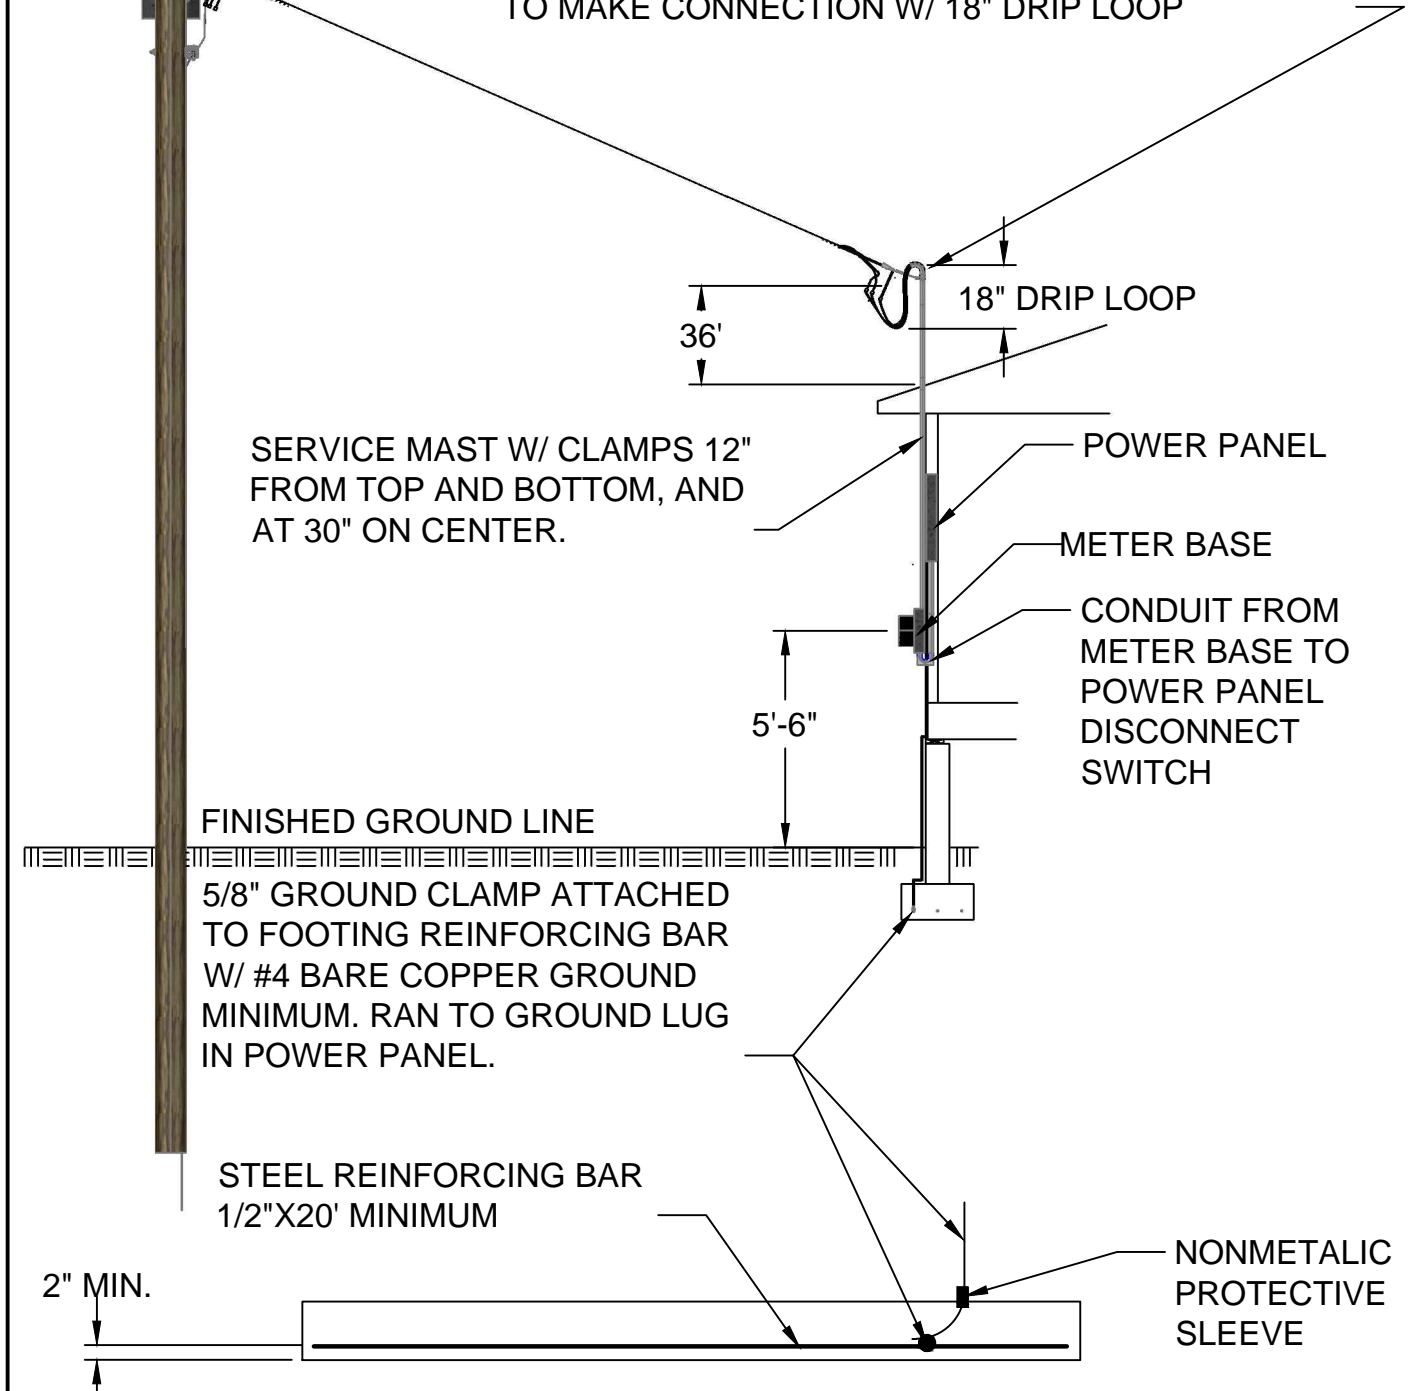

COMPANY: <b>ELIZABETHTON ELECTRIC DEPARTMENT</b>				<b>M8-3</b>			
DETAIL NAME: <b>OVERHEAD SERVICE TO HOME WITH FOOTER GROUND MATERIALS TO BE SUPPLIED BY BUILDER/OWNER</b>							
DRAWN BY: <b>J.E.S.</b>	CHECKED BY:	DATE: <b>07/01/2010</b>	PURPOSE: <b>ASSEMBLY DETAIL</b>	SCALE: <b>3/16"=1'-0"</b>	PAGE: <b>3</b>	OF	PAGES: <b>11</b>