


**NOTE:**

1. POLE IS REQUIRED TO BE SEATED FIRMLY IN THE GROUND, AND BRACED AS TO NOT FALL WHILE BEING CLIMBED, OR UNDER LADDER PRESSURE. POLE IS REQUIRED TO STAND IN INCLEMENT WEATHER.
2. POLE TO BE 4"x4"x16' TALL PRESSURE TREATED, **PROVIDED BY AND IS PROPERTY OF OWNER.**

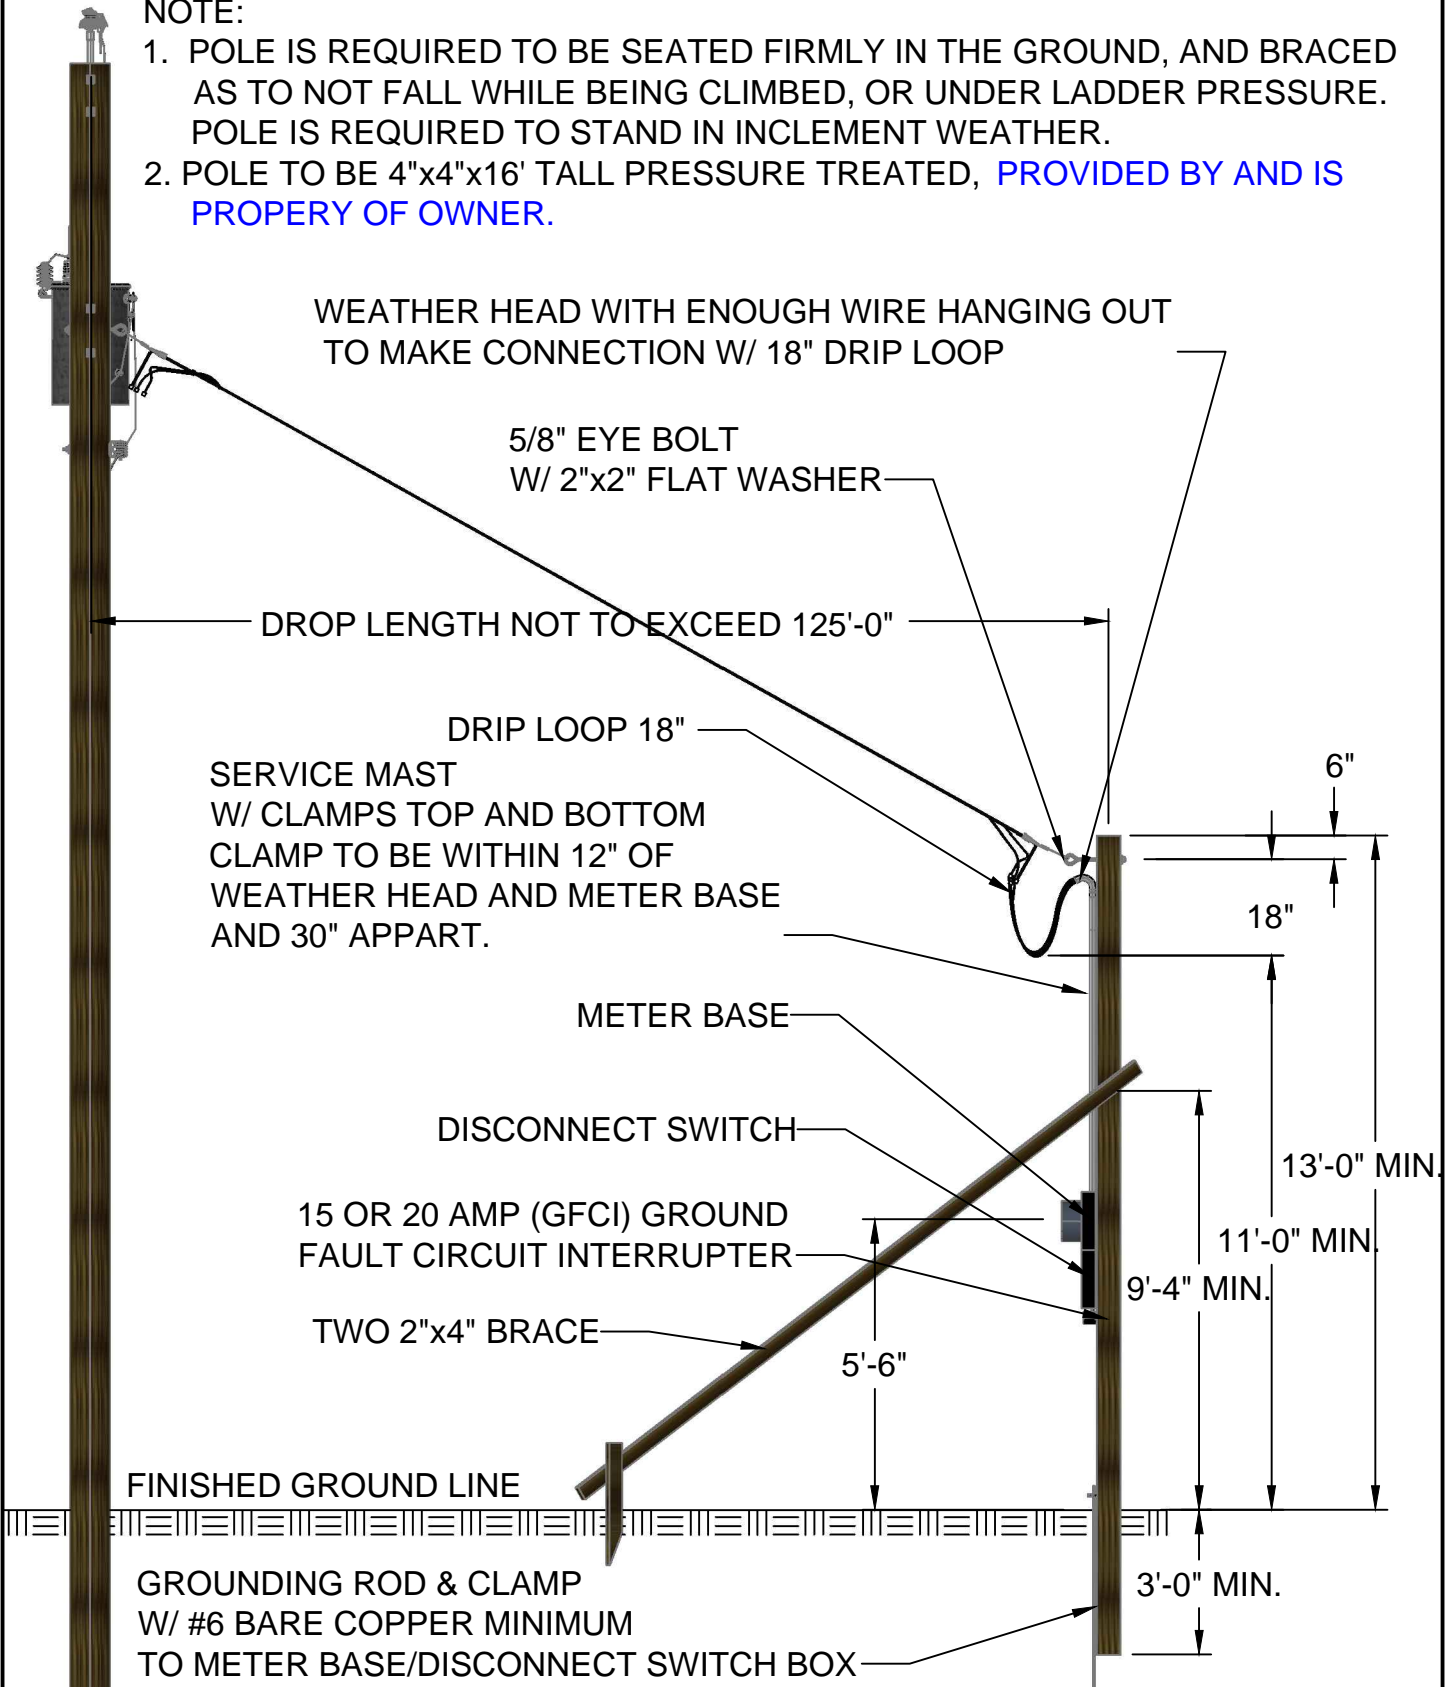

COMPANY:					<b>ELIZABETHTON ELECTRIC DEPARTMENT</b>		<b>M8-7</b>
DETAIL NAME:							
OVERHEAD TEMPORARY SERVICE POLE							
MATERIALS TO BE SUPPLIED BY BUILDER/OWNER							
DRAWN BY:	CHECKED BY:	DATE:	PURPOSE:	SCALE:	PAGE:	OF	PAGES:
J.E.S.		07/01/2010	ASSEMBLY DETAIL	1/4"=1'-0"	7		11